


3/4" & 1" METER PIT INSTALLATION DETAIL

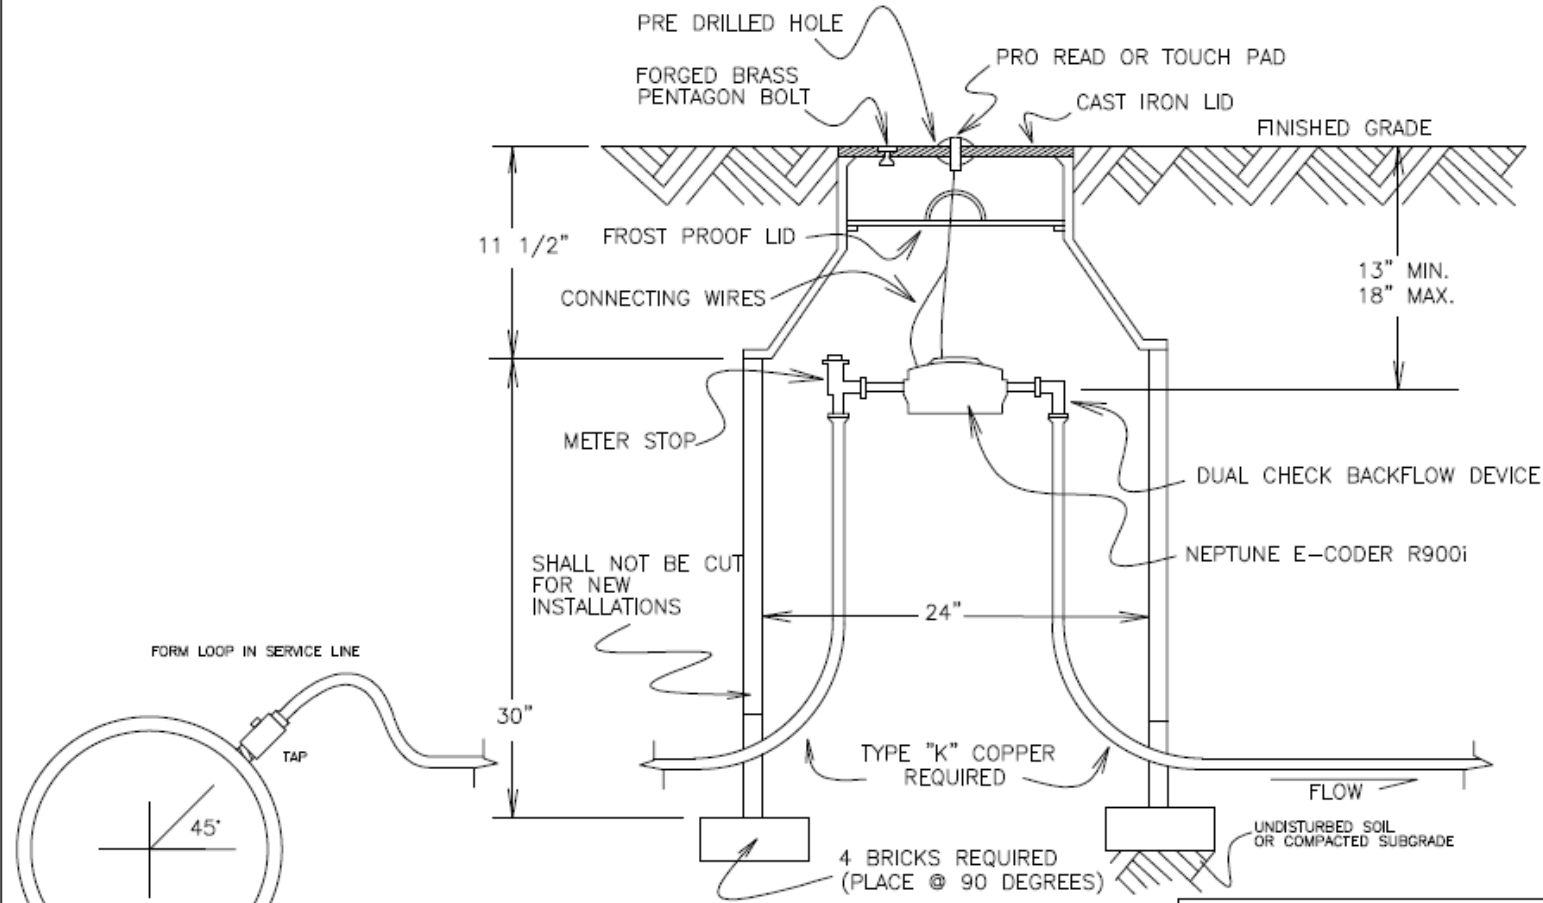

W-5a

- NOTES:
- 1) NO TAPS, SPRINKLER OR OTHERWISE, WILL BE ALLOWED INSIDE THE METER PIT
 - 2) ANY UNIONS USED INSIDE THE METER PIT SHALL HAVE FLARED ENDS
 - 3) IF OVER-EXCAVATED, SOIL UNDER PIT IS TO BE COMPACTED TO 97% STANDARD PROCTOR

METER PIT 3/4" & 1"



CITY OF CAÑON CITY
ENGINEERING DEPARTMENT

STANDARD DETAIL
REVISED: AUGUST 2017

W-5a